


NOTE: CARE SHALL BE EXERCISED TO KEEP HYDRANT DRAIN OPENING FREE TO OPERATE.

TYPE OF HYDRANT SHALL MEET THE REQUIREMENTS OF SPECS. 803.

PIPE SECTION BETWEEN VALVE & HYDRANT SHALL BE ONE ANCHORING
PIPE - CLOW F-1216 OR APPROVED EQUAL-36" MINIMUM.

HYDRANT TO BE PAINTED "CHROME YELLOW"

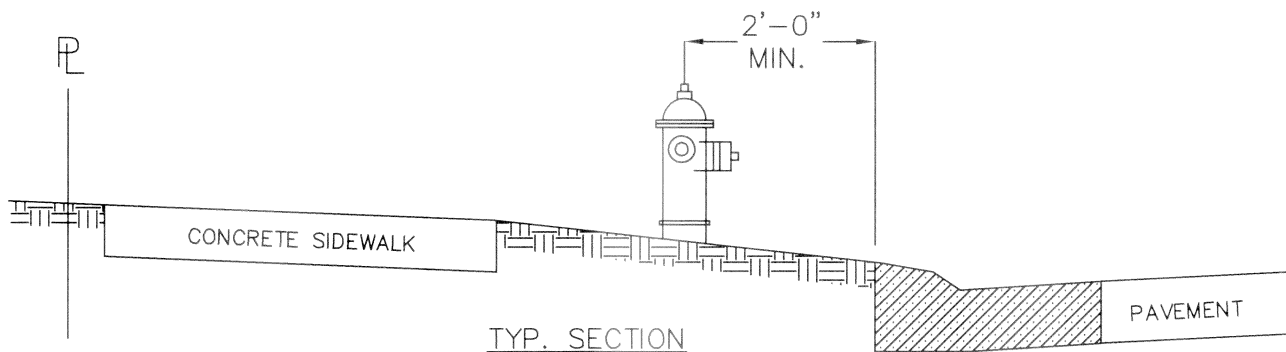

CITY OF NEWARK, OHIO
DIVISION OF ENGINEERING

STANDARD DRAWING 800-5
HYDRANT DETAIL

9-91
PIPES
REVISED
5-96 KELLEY
2-96 KELLEY
2-06 KELLEY