


* WHERE MULTIPLE OUTSIDE SHUT OFF VALVES ARE REQUIRED TO BE INSTALLED ON PRIVATE PROPERTY, SEE STANDARD DRAWING 800-WS3A

NOTE: WATERMAIN TO BE IN STREET AS SHOWN

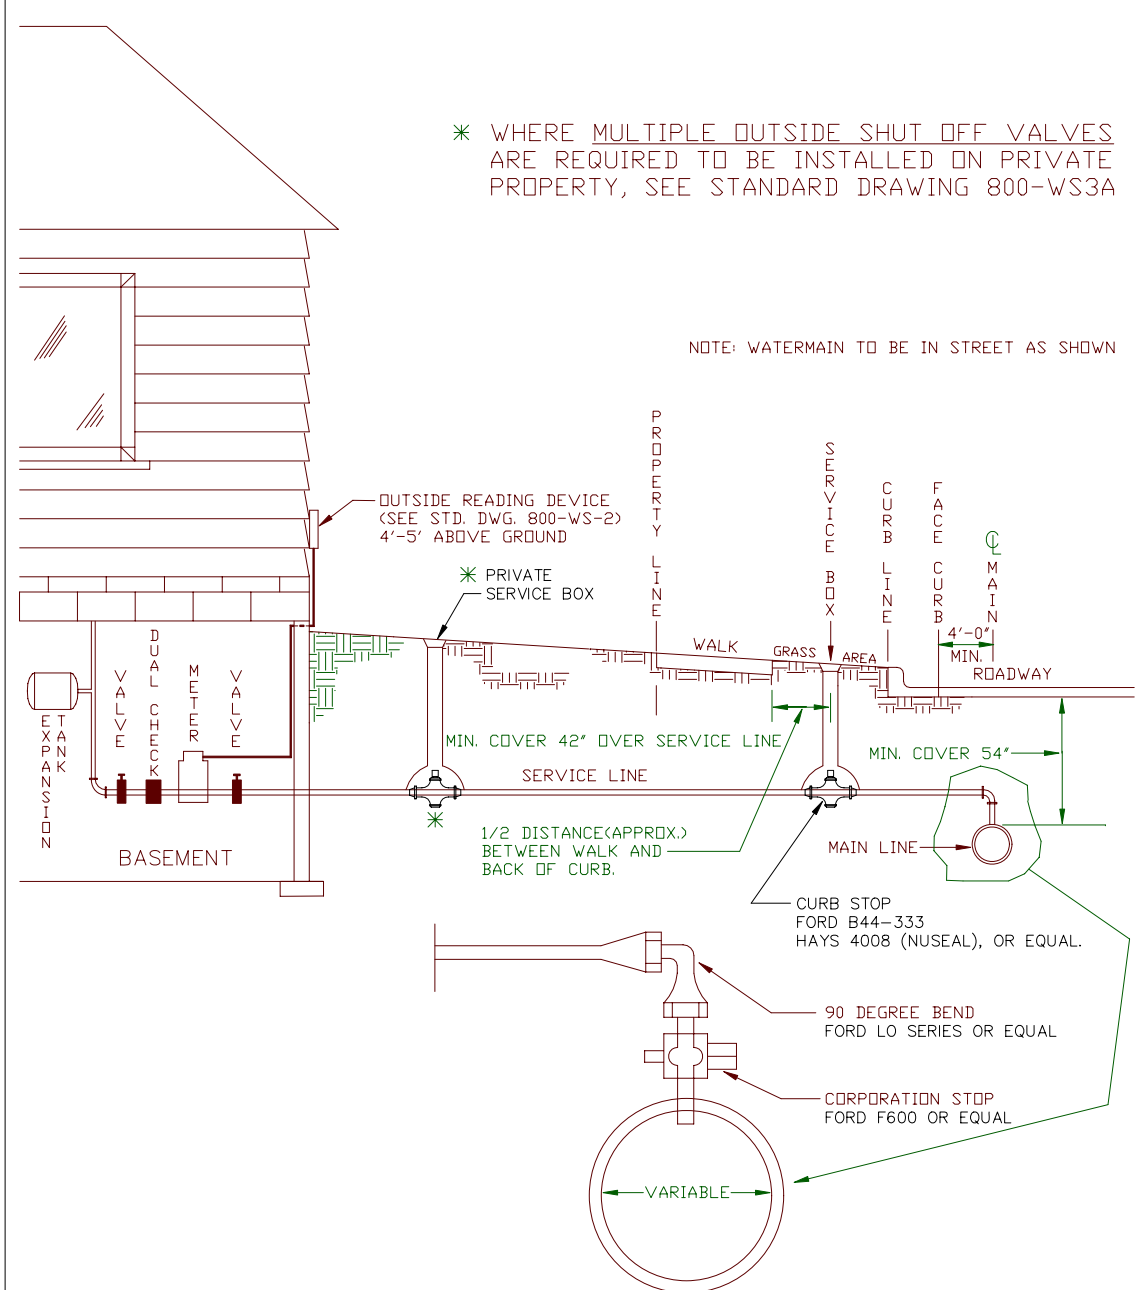

CITY OF NEWARK, OHIO
DIVISION OF ENGINEERING

STANDARD DRAWING 800-WS-3
WATER SERVICE INSTALLATION

6-91
PIPES
REVISED
12-93 KELLEY
6-94 KELLEY
12-94 KELLEY
5-96 KELLEY
7-97 KELLEY
2-98 KELLEY